


FOUNDATIONS WITH UNBALANCED FILL WITH REINFORCING BAR REQUIREMENTS

STANDARD FOUNDATION #1:

FOUNDATIONS FOUR (4) FEET OR LESS WALL HEIGHT: ONLY FOUNDATIONS SET INTO SOLID LEDGE MAY BE LESS THAN FOUR (4) FEET. FOOTINGS MUST BE DRILLED AND PINNED AT SIX FOOT (72") INTERVALS. #3 REBAR MINIMUM IS REQUIRED, INCLUDING 2 PARALLEL BARS IN FOOTINGS AND TOP 12" OF WALL AND VERTICALS 12" TALL - 36" ON CENTER.

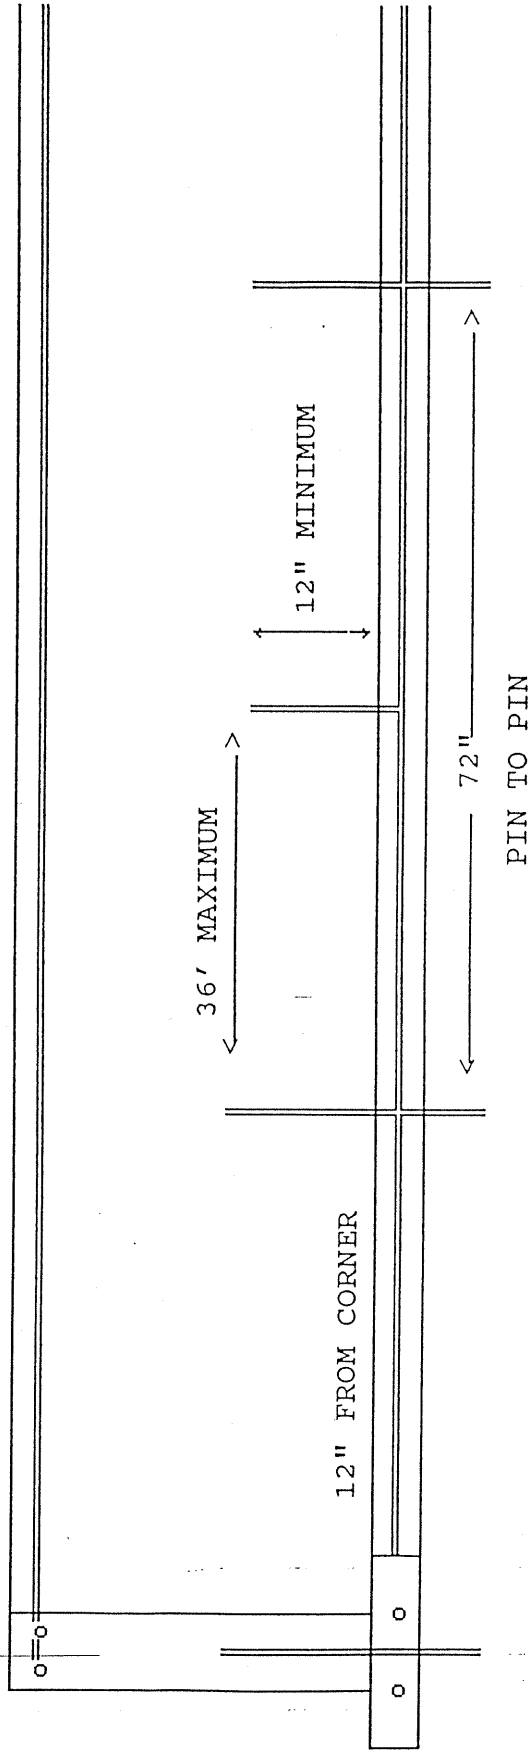


IF YOU DRILL AND PIN TO LEDGE IT MUST BE INSPECTED PRIOR TO POURING FOOTINGS

* ALL DRILLED PINS TO BE 6" MINIMUM AND GROUTED WITH HYDRAULIC CEMENT.

FOUNDATIONS WITH UNBALANCED FILL WITH REINFORCING BAR REQUIREMENTS

STANDARD FOUNDATION #3:

FOUNDATIONS OVER 4 FEET: PINNING REQUIRED IF ON LEDGE. 2 PARALLEL BARS IN FOOTINGS AND TOP 12" OF WALL AND SINGLE BAR INTO MIDDLE OF WALL. # 4 REBAR MINIMUM.

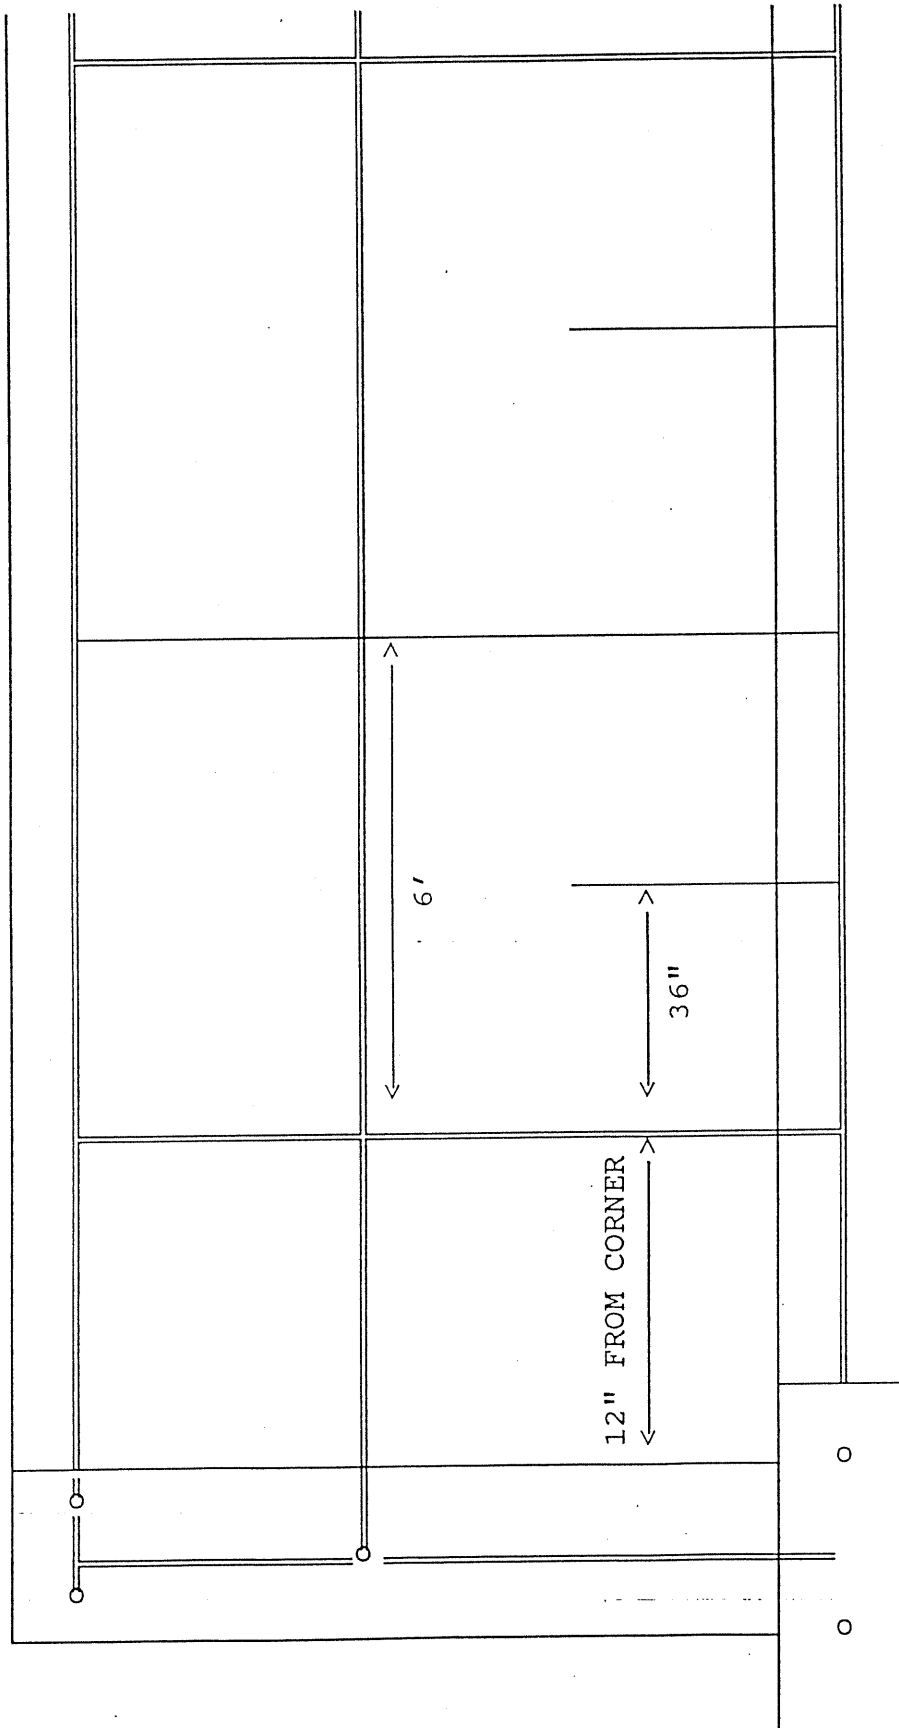


* 2 INSPECTIONS REQUIRED ON 8 FOOT WALLS: 1ST. INSPECTION WHEN FOOTINGS ARE COMPLETED, FORMS ARE UP AND REBAR IS IN PLACE; 2ND. INSPECTION AFTER WATERPROOFING IS COMPLETED, BUT BEFORE BACKFILLING IS DONE.

FOUNDATIONS WITH UNBALANCED FILL WITH REINFORCING BAR REQUIREMENTS

STANDARD FOUNDATION #2:

4 FOOT FOUNDATIONS: FOUNDATIONS IN NORMAL SOILS MUST BE A MINIMUM OF 4 FEET TO FROST LEVEL.
3 REBAR MINIMUM. TWO PARALLEL BARS IN TOP 12" OF WALL AND FOOTINGS.

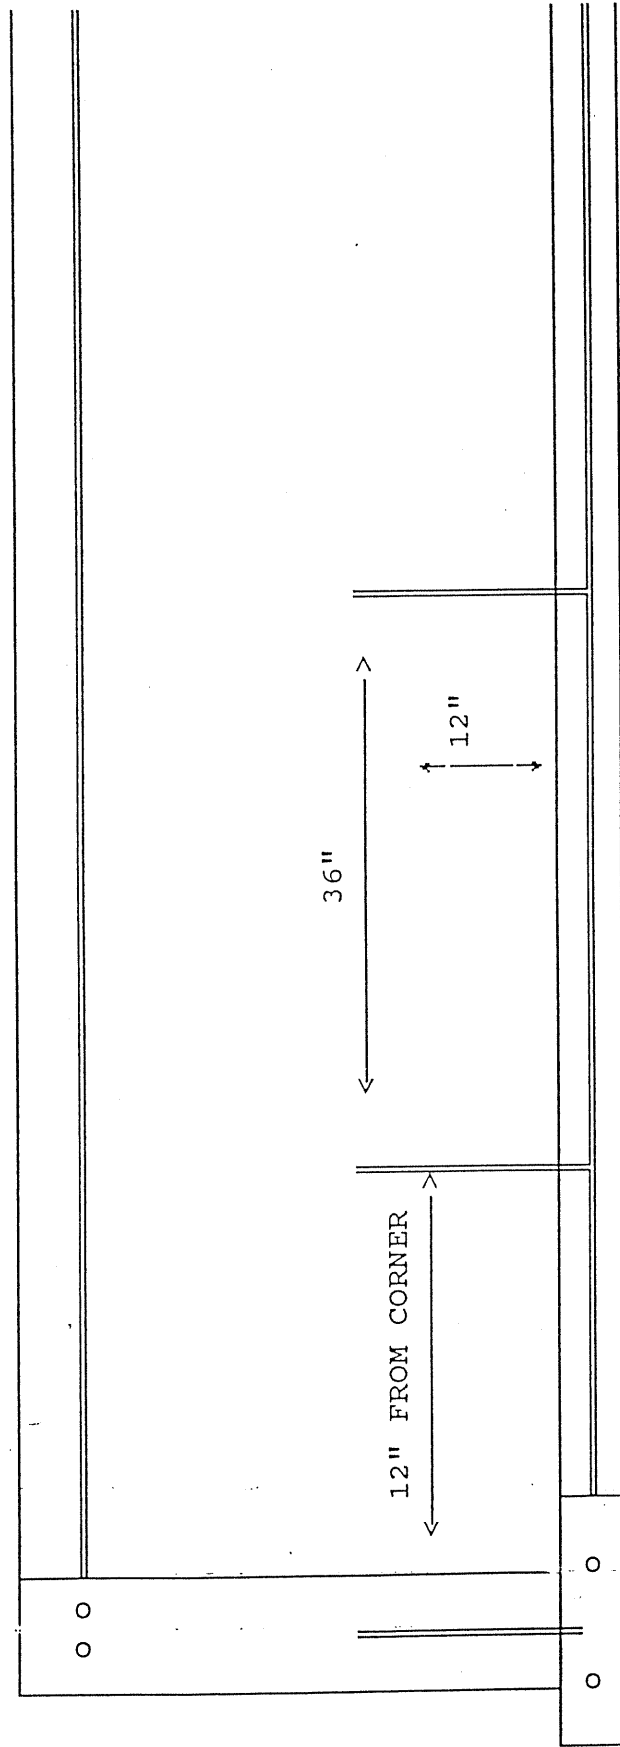

* 2 INSPECTIONS ARE REQUIRED FOR 4 FOOT WALLS: 1ST. INSPECTION WHEN FOOTINGS ARE COMPLETE;
2ND. INSPECTION AFTER THE WATERPROOFING IS COMPLETED, BUT BEFORE ANY BACKFILLING IS DONE.